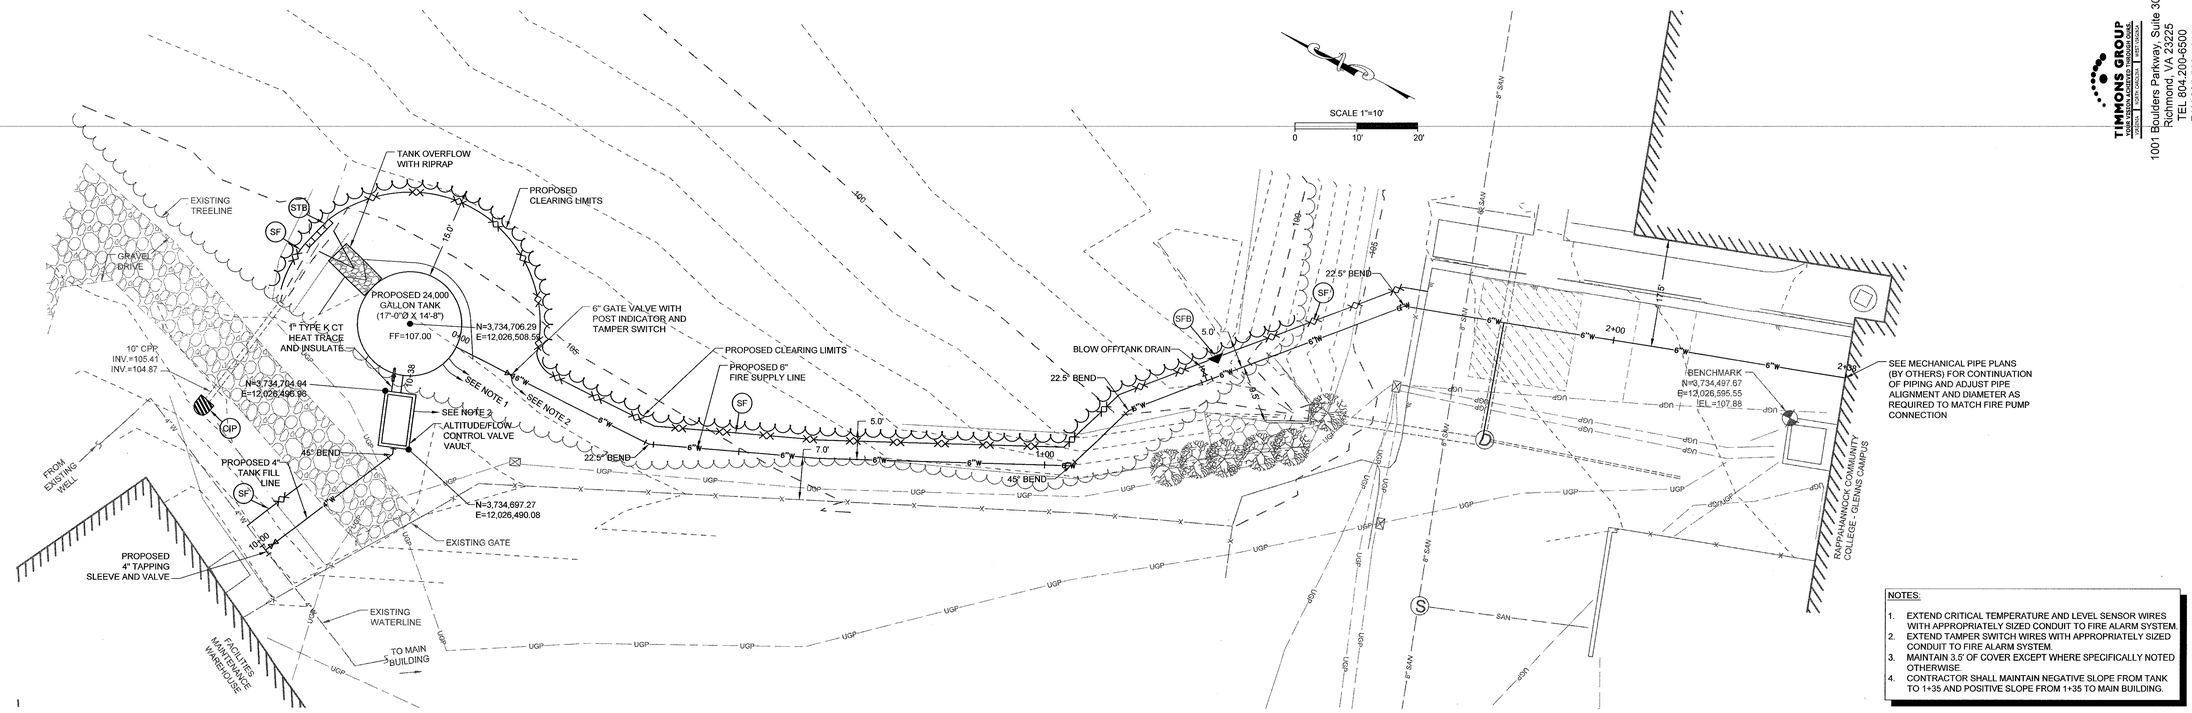

SITE PLAN

NOTES:

1. EXTEND CRITICAL TEMPERATURE AND LEVEL SENSOR WIRES WITH APPROPRIATELY SIZED CONDUIT TO FIRE ALARM SYSTEM.
2. EXTEND TAMPER SWITCH WIRES WITH APPROPRIATELY SIZED CONDUIT TO FIRE ALARM SYSTEM.
3. MAINTAIN 3.5' OF COVER EXCEPT WHERE SPECIFICALLY NOTED OTHERWISE.
4. CONTRACTOR SHALL MAINTAIN NEGATIVE SLOPE FROM TANK TO 1+35 AND POSITIVE SLOPE FROM 1+35 TO MAIN BUILDING.

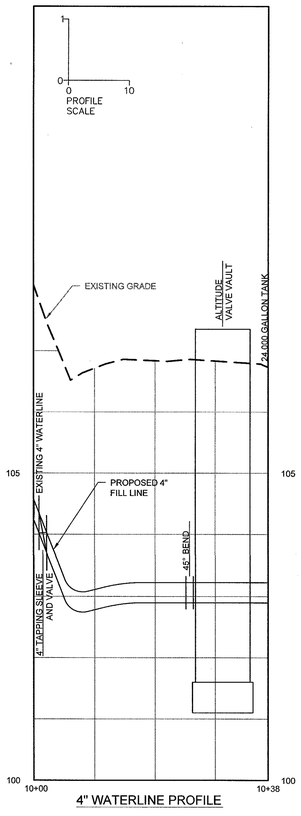

4" WATERLINE PROFILE

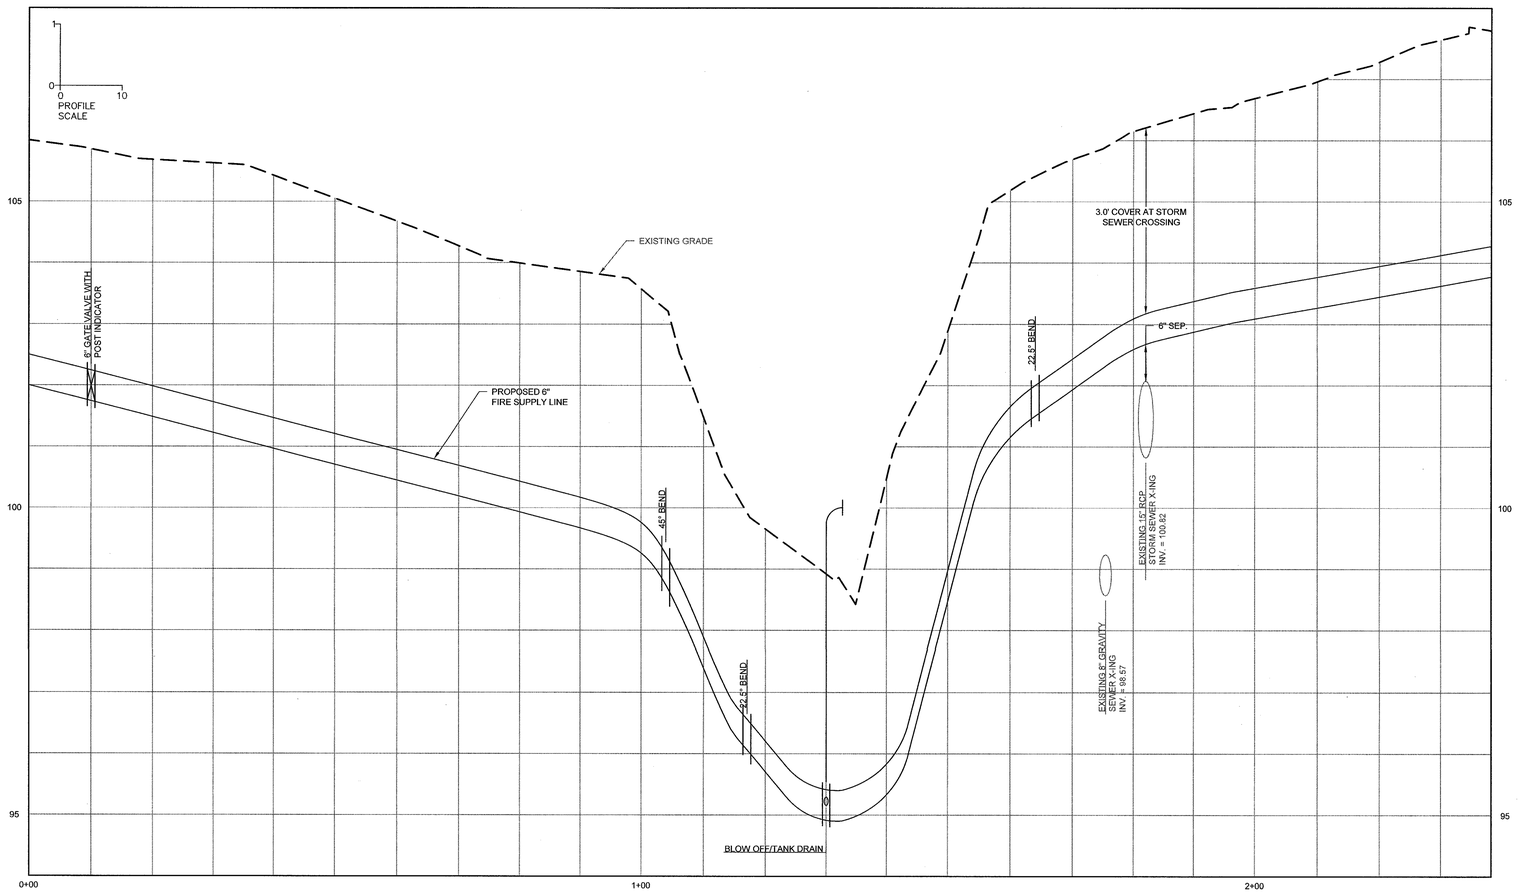

6" WATERLINE PROFILE

TIMMONS GROUP
YOUR VISION ACHIEVED THROUGH OUR PEOPLE
1001 Boulders Parkway, Suite 300
Richmond, VA 23225
TEL 804.200-6500
FAX 804.560-1016

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Glen Allen, Virginia 23059
☎ (804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

SITE PLAN AND WATERLINE PROFILE

Date: MAY 11, 2010

REVISIONS

NO.	DATE

COMMONWEALTH OF VIRGINIA
WESLEY G. HUNNIUS
Lic. No. 040151
5/11/10
PROFESSIONAL ENGINEER

Sheet
U1.1

File Number
28389